


0 SLCryoOk1_1 SLCryoOk1_2 SLCryoOk2_1 SLCryoOk2_2 SLCryoOk3 SLCryoOk4 SLCryoOk5 SLCryoOk6
 CryoOk to CryoOk to CryoOk to CryoOk to CryoOk to CryoOk to CryoOk to CryoOk to
 Solenoid Pos 1 Solenoid Pos 1 Solenoid Pos 2 Solenoid Pos 2 Solenoid Pos 3 Solenoid Pos 4 Solenoid Pos 5 Solenoid Pos 6

5 6 7 8 9
 Pannel1 GREEN Pannel1 YELLOW Pannel1 RED Pannel2 GREEN Pannel2 YELLOW Pannel2 RED
 No access Access B.170 not authorized

Please refer to original reference document stored in EDMS N° 1538023

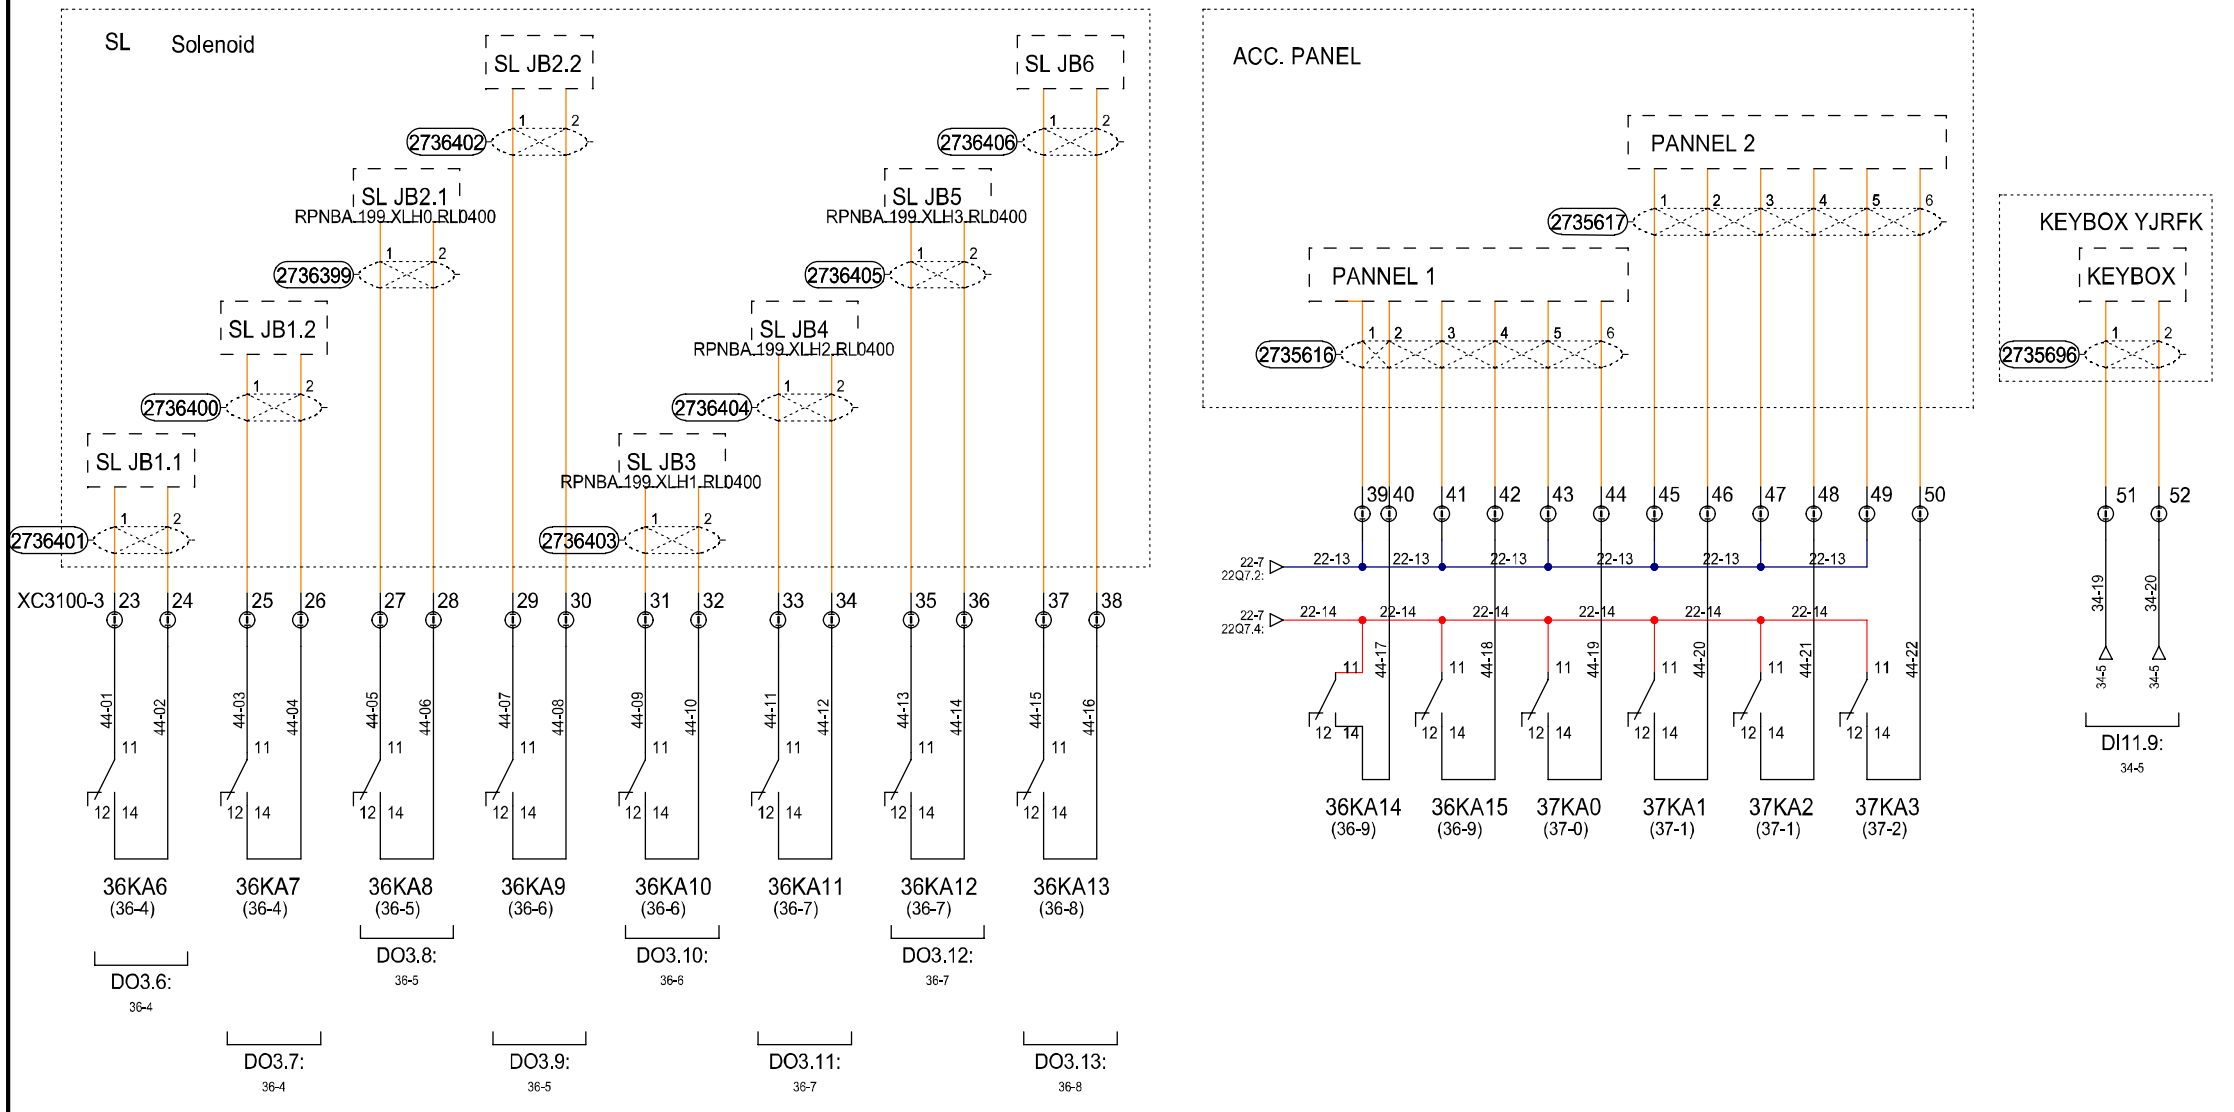

Revision	Date	Name	Modifications

HIE-ISOLDE
 QSK1H-QYC31=199 Client PLC + Profibus DP/PA
 Interface Bornier 1.3 SL/acc. panels

Draughtsman :
 A.Toral
 Date :
 24/08/2015



Número EDMS :
 1538023
 File Index B